



de Montageanleitung
en Mounting instructions
fr Instructions de montage
sv Monteringsinstruktion
nl Montage-aanwijzing
it Istruzioni di montaggio
fi Asennusohje
es Instrucciones de montaje
da Monteringsvejledning

Differenzdruckfühler
Differential Pressure Sensors
Sonde de pression différentielle
Differenstryckgivare
Drukverschilopnemer
Sonda di pressione differenziale
Paine-eroanturit
Sondas de diferencia de presión
Trykdifferensføler


QBM4000-..
QBM4100-..

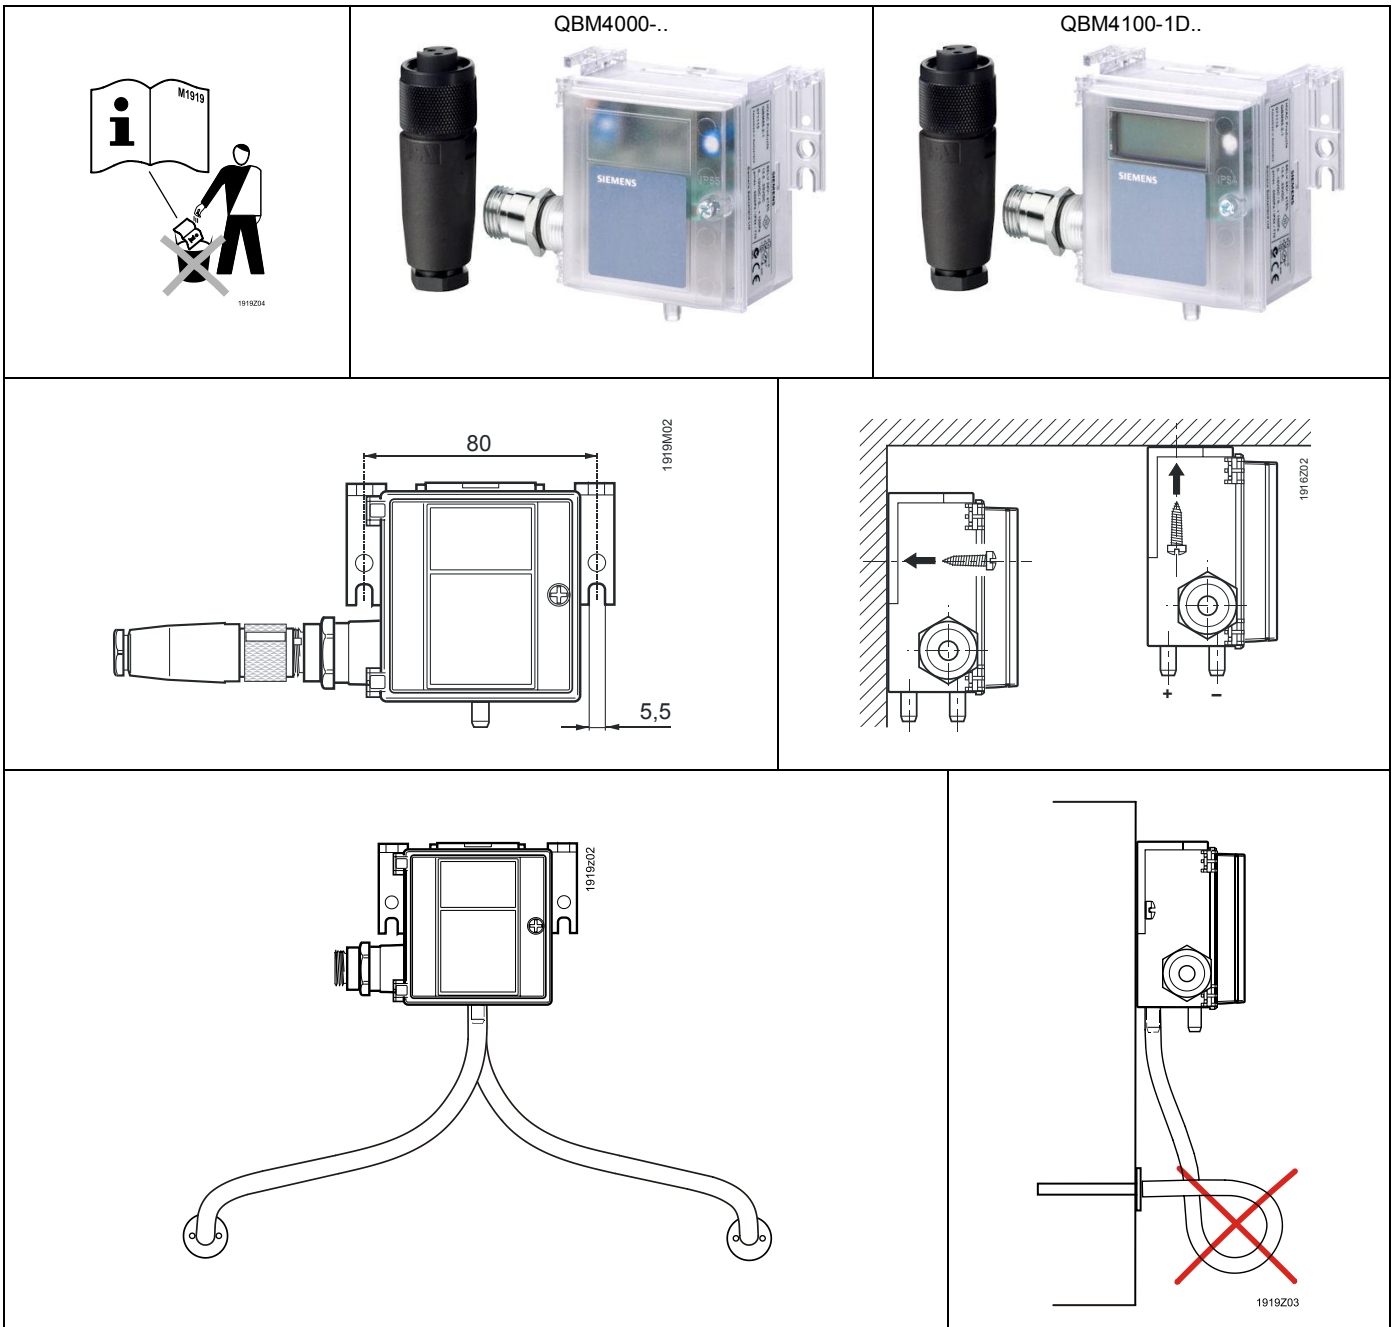


QBM4000-..
Output 0...10 V





Pin
3 (GL)
1 (U1)
2 (M)

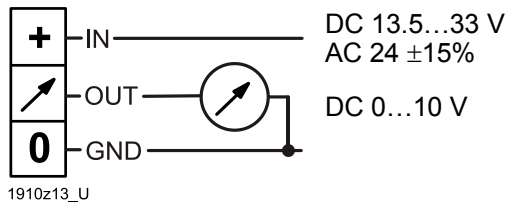

QBM4100-..
Output 4...20 mA



Pin
3 (G)
1 (I)
2 (-)

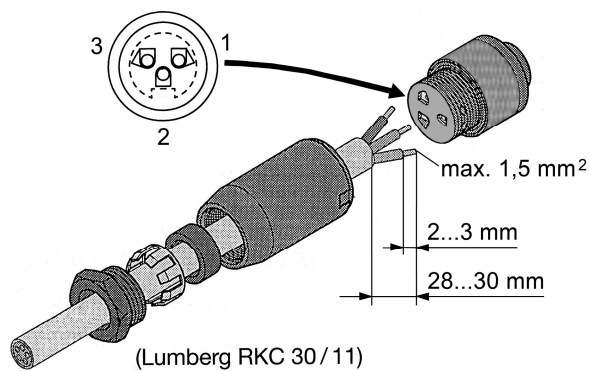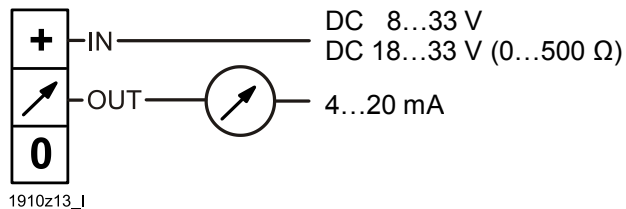

For additional
information please
refer to the
[Sensor Installation
Handbook](#)

and
[http://siemens.com/bt/
download](http://siemens.com/bt/download)



→ search for
"QBM4000" or
"QBM4100"